

The Automotive Research Association of India

(Research Institute of the Automotive Industry with Ministry of Heavy Industries & Public Enterprises, Govt. of India)

CONFIDENTIAL

TEST REPORT ON DETERMINATION OF SOUND TRANSMISSION LOSS OF 96 MM THICK METAL STUD PARTITION SYSTEM

No. NVH/8278/2016-17/590 (V-4)-2

13th January 2017

1.0 CUSTOMER NAME

Ramco Industries Ltd. 52, R.K. Mutt Road, I floor, Mylapore Chennai – 600 004,

Tamilnadu

2.0 LETTER REF.

F-mail dated 23rd December 2016

3.0 TEST COMPONENT

96 mm thick metal stud partition system with following details given by customer. Please refers Annexure 1 for isometric view and elevation drawing and details of 96 mm thick metal stud partition system.

Main System : 96 mm thick metal stud partition comprising of a composite framework which includes a 70mm G.I stud of 0.55 mm thick and having two unequal flanges of 34 and 36 mm each placed at 610 mm center to center in 72 mm G.I floor and ceiling channel with two equal flanges of 32 mm each fixed to floor and ceiling. This is done with the help of nylon sleeves and wood screws with a gap of 600 mm.

Single layer of 12 mm thick and 1200 -1250 kg/m³ density Hicem flexo boards are then screw fixed to the studs and channels at 200 mm centres on both sides of the frame work, with 25 mm long G.I self-drilling & tapping screws having Phillips head The board's joints are to be staggered to avoid through passage

Insulation

: 50 mm thick (Density - 48 kg/m³) Rock wool mat

is to be placed in the cavity of the partition.

Jointing and Finishing : Finally edges of the facing boards are to be jointed and finished so as to have a seamless finish which includes filling and finishing with specially formulated jointing compound and 48 mm wide self-adhesive fibre tape.

4.0 TEST REQUIREMENTS

Measurement of sound transmission loss of above mentioned 96 mm thick metal stud partition system as per ISO 10140-2 / ASTM E-90 and determination of sound transmission class (STC) as per ASTM E- 413 and weighted sound reduction index R_w (C; C_{tr}) with spectrum adaptation terms as per ISO 717-1.

Page 1 of 6





No. NVH/8278/2016-17/590 (V-4)-2

13th January 2017

5.0 TEST PROCEDURE

The above mentioned 96 mm thick metal stud partition system of size 2.4 m x 2.4 m was mounted in the wall between two reverberation chambers and sealed all around at edges. Please refer figure 1 for test set up and mounting of system. The airborne sound transmission loss test was carried out five times on same system from both sides in a reverberation chambers and average value reported as per ISO 10140-2 / ASTM E-90 standard at temperature 25°C ± 1°C and humidity 46%.

6.0 DATE OF EVALUATION

Test was carried out on 96 mm thick metal stud partition system on 11th January 2017 at NVH laboratory, ARAI-Pune in presence of Ramco Industries Ltd representative Mr. Nareshkumar A.

7.0 INSTRUMENTATION

Sr. No	Instrument Name	Type / Model No	Make	Calibrated on	Calibration due on			
1	Multi-channel Data Acquisition System	3560 D	Bruel & Kjaer, Denmark	14-Jun-16	14-Jun-17			
2	½" Random Incidence Microphone	378B20 (Sr. No. 109015 and Sr. No. 109016)	PCB, USA	16-Jun-16	16-Jun-17			
3	Power Amplifier	2716	Bruel & Kjaer, Denmark	-	-			
4	Omni directionnel sound source	Omni power 4296	Bruel & Kjaer, Denmark	-	-			
5	Reverberation Chambers	80 m³ and 110 m³	-	-	-			

8.0 TEST RESULTS

Table 1 and figure 2 shows the values and plot for sound transmission loss of 96 mm thick metal stud partition system in the one-third octave frequency bands of 100 Hz to 8000 Hz, STC (sound transmission class) and R_W (C100-5000; Ctr100-5000) (weighted sound reduction index and spectrum adaptation terms).



No. NVH/8278/2016-17/590 (V-4)-2

13th January 2017

9.0 CONCLUSIONS

The sound transmission class (STC) is calculated as per ASTM E- 413 and weighted sound reduction index with spectrum adaptation terms Rw (C100-5000; Ctr100-5000) is calculated as per ISO 717-1 for 96 mm thick metal stud partition system									
Sound transmission class (STC)	52 dB								
Weighted sound reduction index with spectrum adaptation terms R _w (C ₁₀₀₋₅₀₀₀ ;C _{tr100-5000})	52 (-1; -6) dB								

Report Prepared By:

Reviewed By:

Approved By:

M. P. Joshi Manager S. K. Jain

Dy. General Manager

N. V. Karanth

Sr. Deputy Director & HoD


This test report pertains only to the systems actually tested at ARAI in the presented condition. The issuing of this test report does not indicate any measure of approval, certification, supervision, control of quality surveillance by ARAI of any product. No extract, abridgement or abstraction from this test report be published or used to advertise the product without the written consent of the Director, ARAI, who reserves the absolute right to agree or reject all or any of the details of any items of publicity for which consent may be sought.






No. NVH/8278/2016-17/590 (V-4)-2

13th January 2017

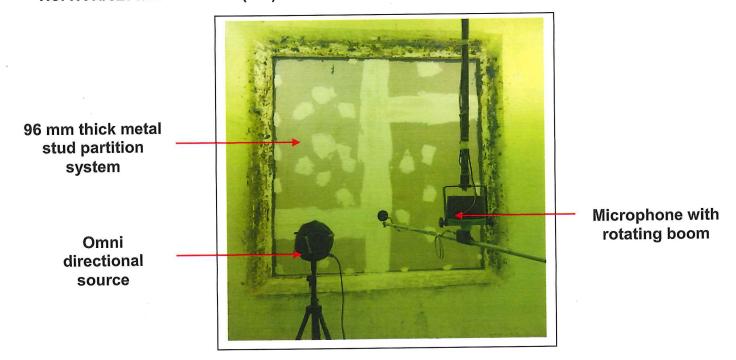

Source Room

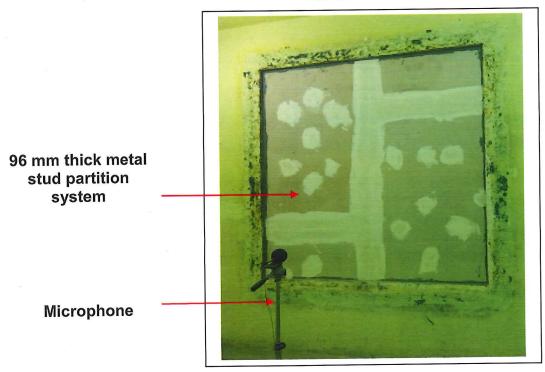

Receiver Room

Figure 1: The test set up for mounting of 96 mm thick metal stud partition system between two reverberation chambers




No. NVH/8278/2016-17/590 (V-4)-2

Table 1 and Figure 2: Values and plot for Sound Transmission Loss of 96 mm thick metal stud partition system at one third octave frequencies

13th January 2017

L																									
- 10 0	Standard	Deviation		2.6	2.7	2.0	2.2	1.5	2.1	1.6	1.5	1.3	1.3	1.2	1.4	1.6	1.0	0.7	0.7	6.0	1.3	0.9	0.4		•
	Sound	Transmission	Loss, dB	31.4	36.0	36.3	37.6	38.6	42.1	48.1	52.1	55.7	58.8	62.1	64.2	63.7	54.3	49.4	54.9	59.9	63.1	67.2	70.3	52	52 (-1; -6)
	One Third	Octave	Frequency, Hz	100	125	160	200	250	315	400	200	630	800	1000	1250	1600	2000	2500	3150	4000	2000	6300	8000	STC	R _w (C; C _{tr})

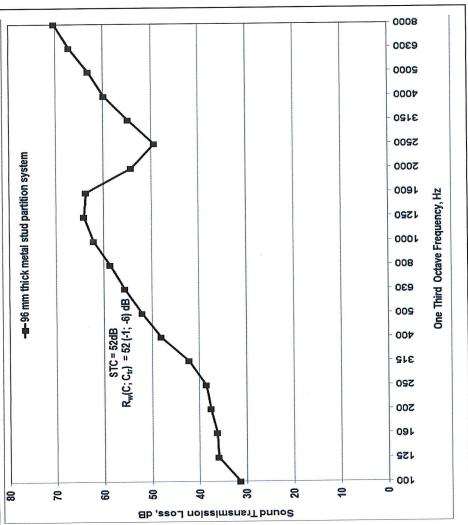

The Measurement Uncertainty in sound transmission loss evaluation is ± 3 dB from 125 Hz to 630 Hz and ± 1.5 dB above 630 Hz with 95.45 % confidence level and K= 2. The measurement uncertainty has been computed at one third octave frequency band from 125 Hz to 8000 Hz.



Annexure 1

